



HOW TO CITE:

Tshubwana RP, Gomes C, Van Coller J, Regnier TJC. Microbiological growth analysis on a 275 kV transmission line composite insulator in South Africa [supplementary material]. S Afr J Sci. 2024;120(1/2), Art. #15629. <https://doi.org/10.17159/sajs.2024/15629/suppl>

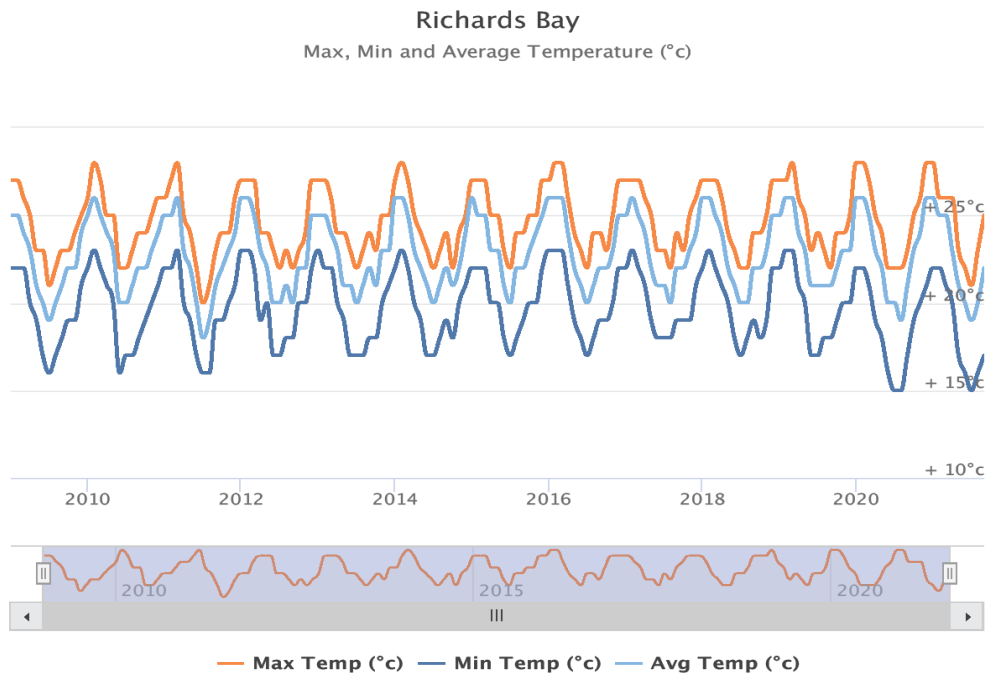

Data source: South African Weather Service


Supplementary figure 1: Richard’s Bay average, minimum and maximum temperatures, 2010–2020.

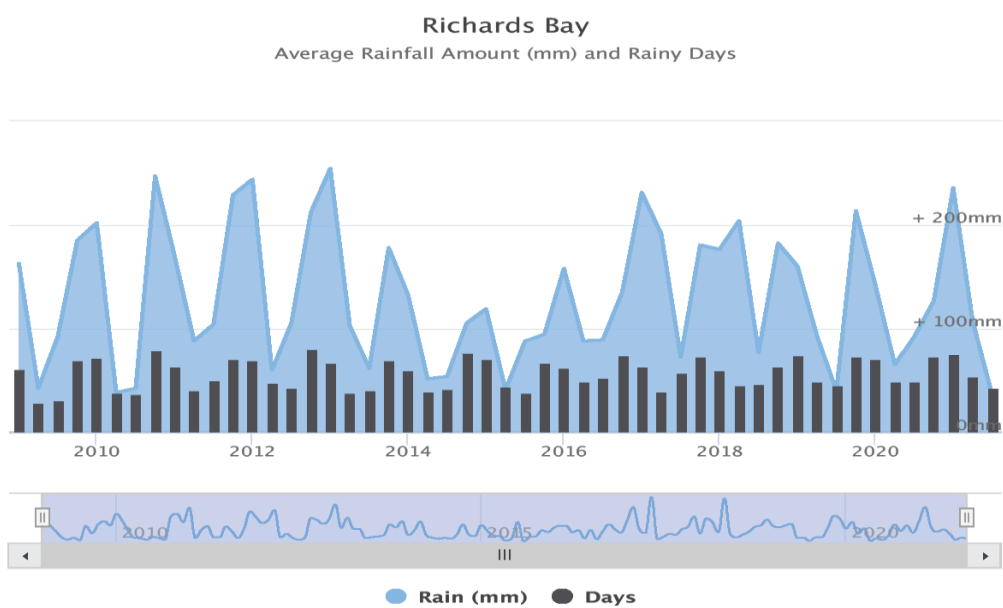

Data source: South African Weather Service

Supplementary figure 2: Richard’s Bay average rainfall and number of rainy days, 2010–2020.


Richards Bay
Average Pressure (mb)

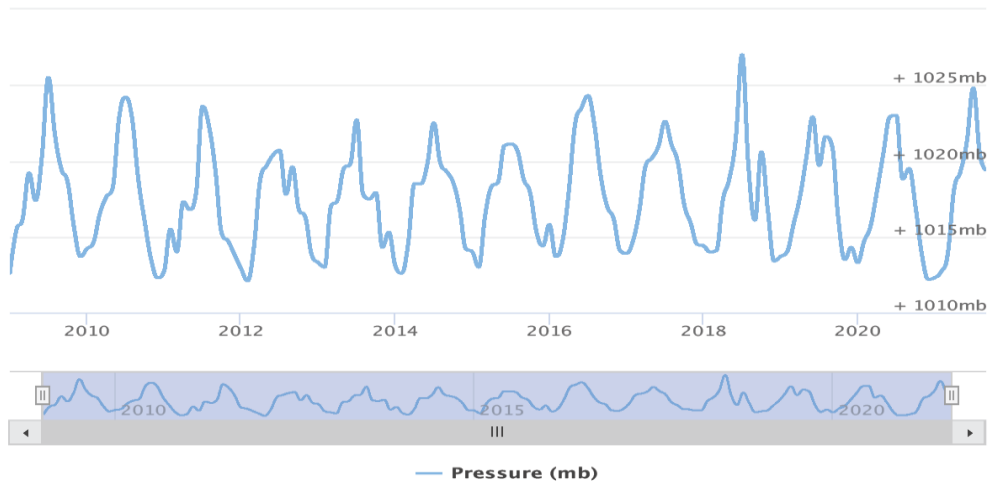

Data source: South African Weather Service


Supplementary figure 3: Richard's Bay average pressure, 2010–2020.

Richards Bay
Average Cloud and Humidity (%)

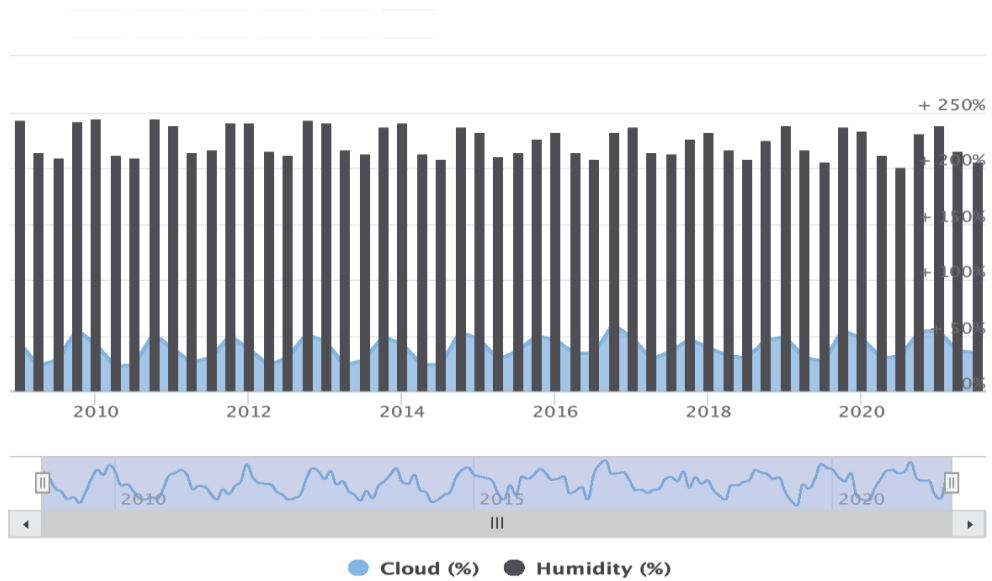


Data source: South African Weather Service

Supplementary figure 4: Richard's Bay average cloud cover and relative humidity, 2010–2020.

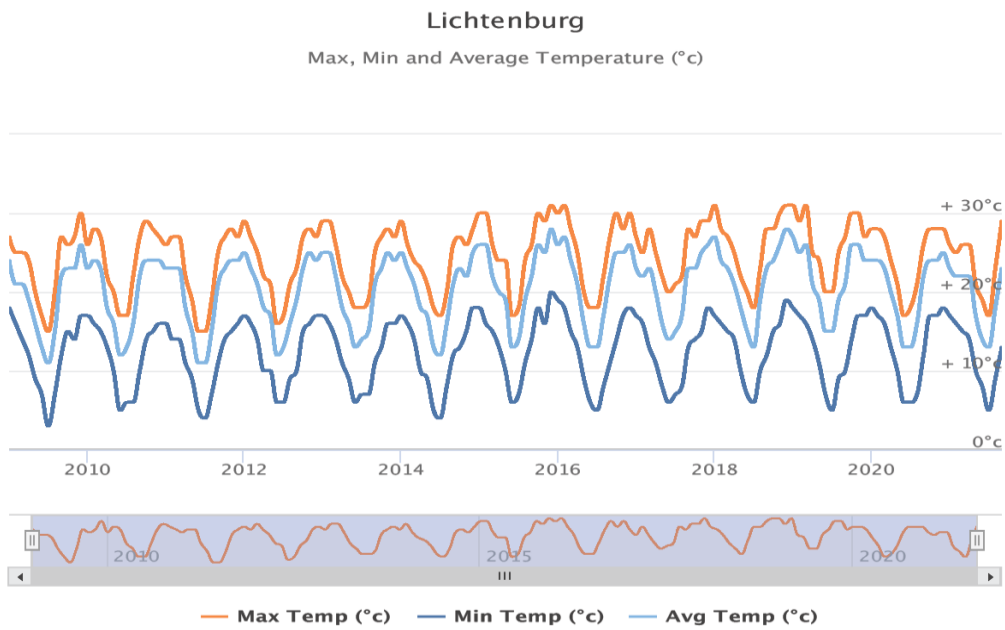


Data source: South African Weather Service

Supplementary figure 5: Lichtenburg average, minimum and maximum temperatures, 2010–2020.

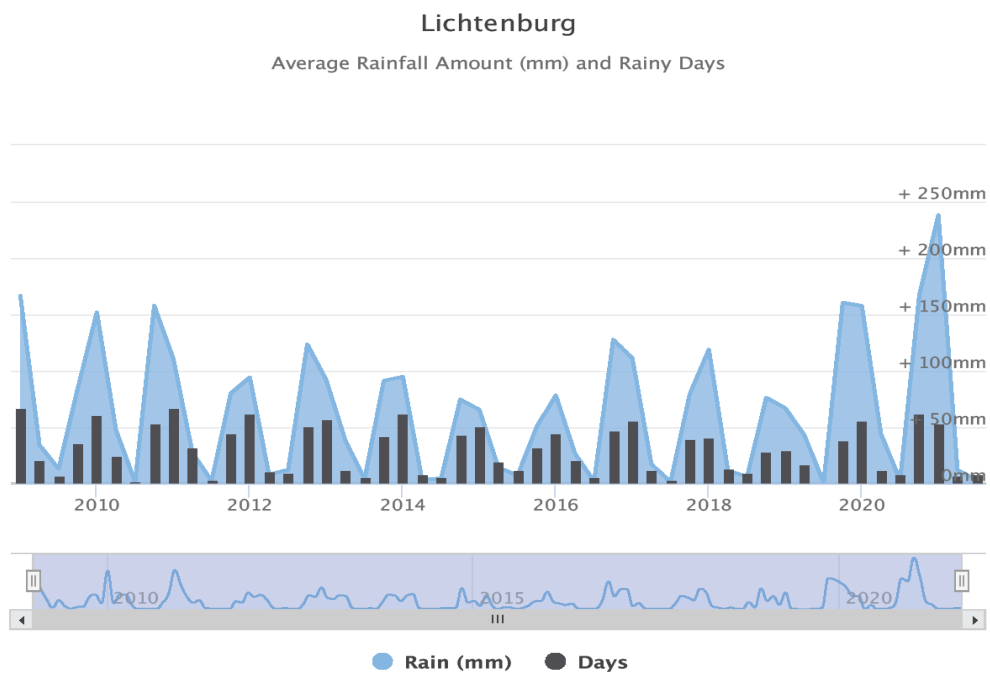


Data source: South African Weather Service

Supplementary figure 6: Lichtenburg average rainfall and number of rainy days, 2010–2020.

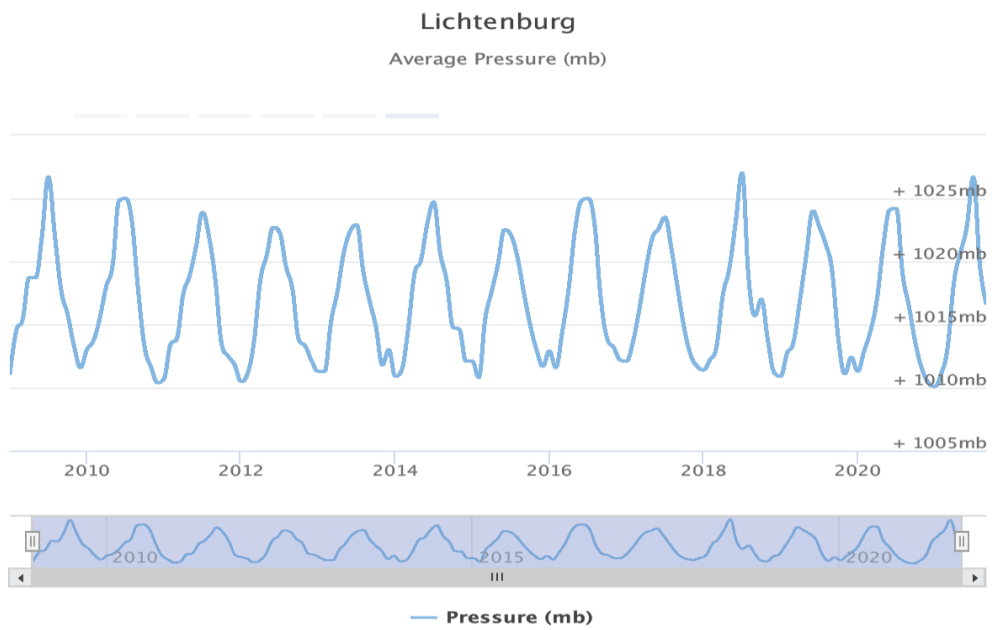

Data source: South African Weather Service

Supplementary figure 7: Lichtenburg average pressure, 2010–2020.

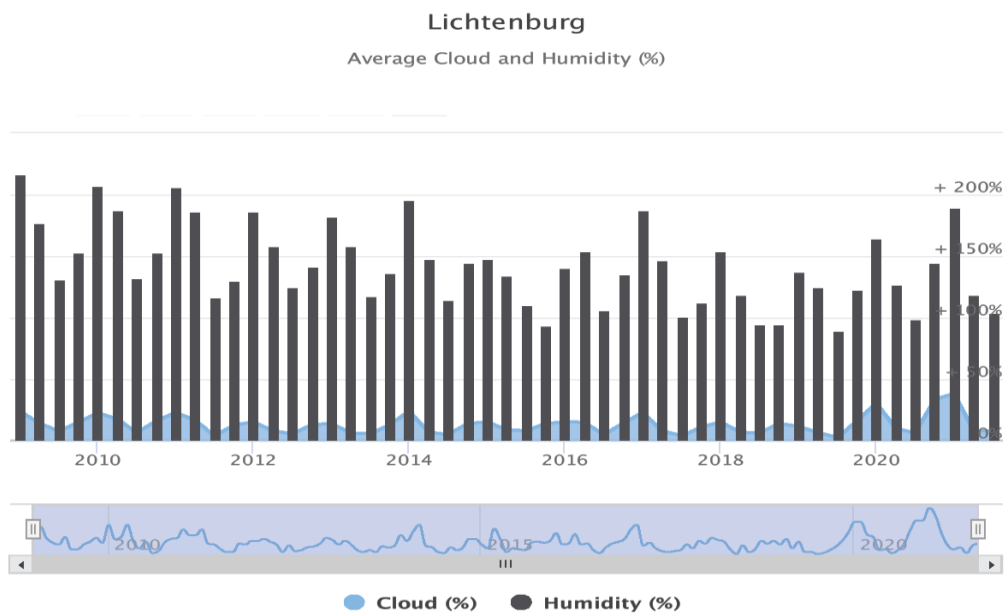

Data source: South African Weather Service

Supplementary figure 8: Lichtenburg average cloud cover and relative humidity, 2010–2020.